


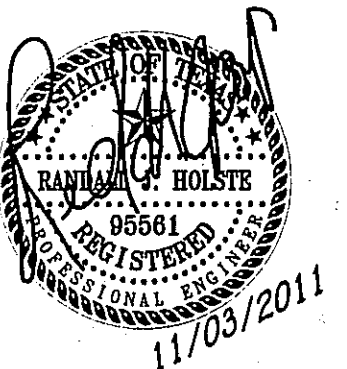

ISSUE
10-24-11 LANDLORD REVIEW
11-03-11 ISSUED FOR PERMIT AND PRICING

PLUMBING KEYED NOTES

(FOR SHEET P1.1)


- 1 EXISTING 6000 GALLON GREASE TRAP TO REMAIN.
- 2 EXISTING SAMPLING WELL TO REMAIN.
- 3 EXISTING GRADE CLEANOUT TO REMAIN.
- 4 REFER TO SHEET P1.2 FOR PLUMBING ENLARGED PLAN.

GREASE TRAP SIZE ANALYSIS

FIXTURE	DFU/FIXTURE	NO. FIXTURES	TOTAL DFU
NEW/EXISTING FLOOR DRAIN	3	10	30
NEW/EXISTING FLOOR SINK	3	6	18
NEW/RELOCATED HAND SINK	1	3	3
EXISTING FLOOR SINK (3 COMP SINK)	6	1	6
EXISTING FLOOR SINK (DISHWASHER)	6	1	6
TOTAL DFU TO GREASE TRAP			63

MINIMUM SIZE OF GREASE TRAP REQUIRED PER TABLE 10-3 OF 2006 UPC IS 1250 GALLONS

EXISTING GREASE TRAP IS 6000 GALLONS - NO CHANGE IS REQUIRED.

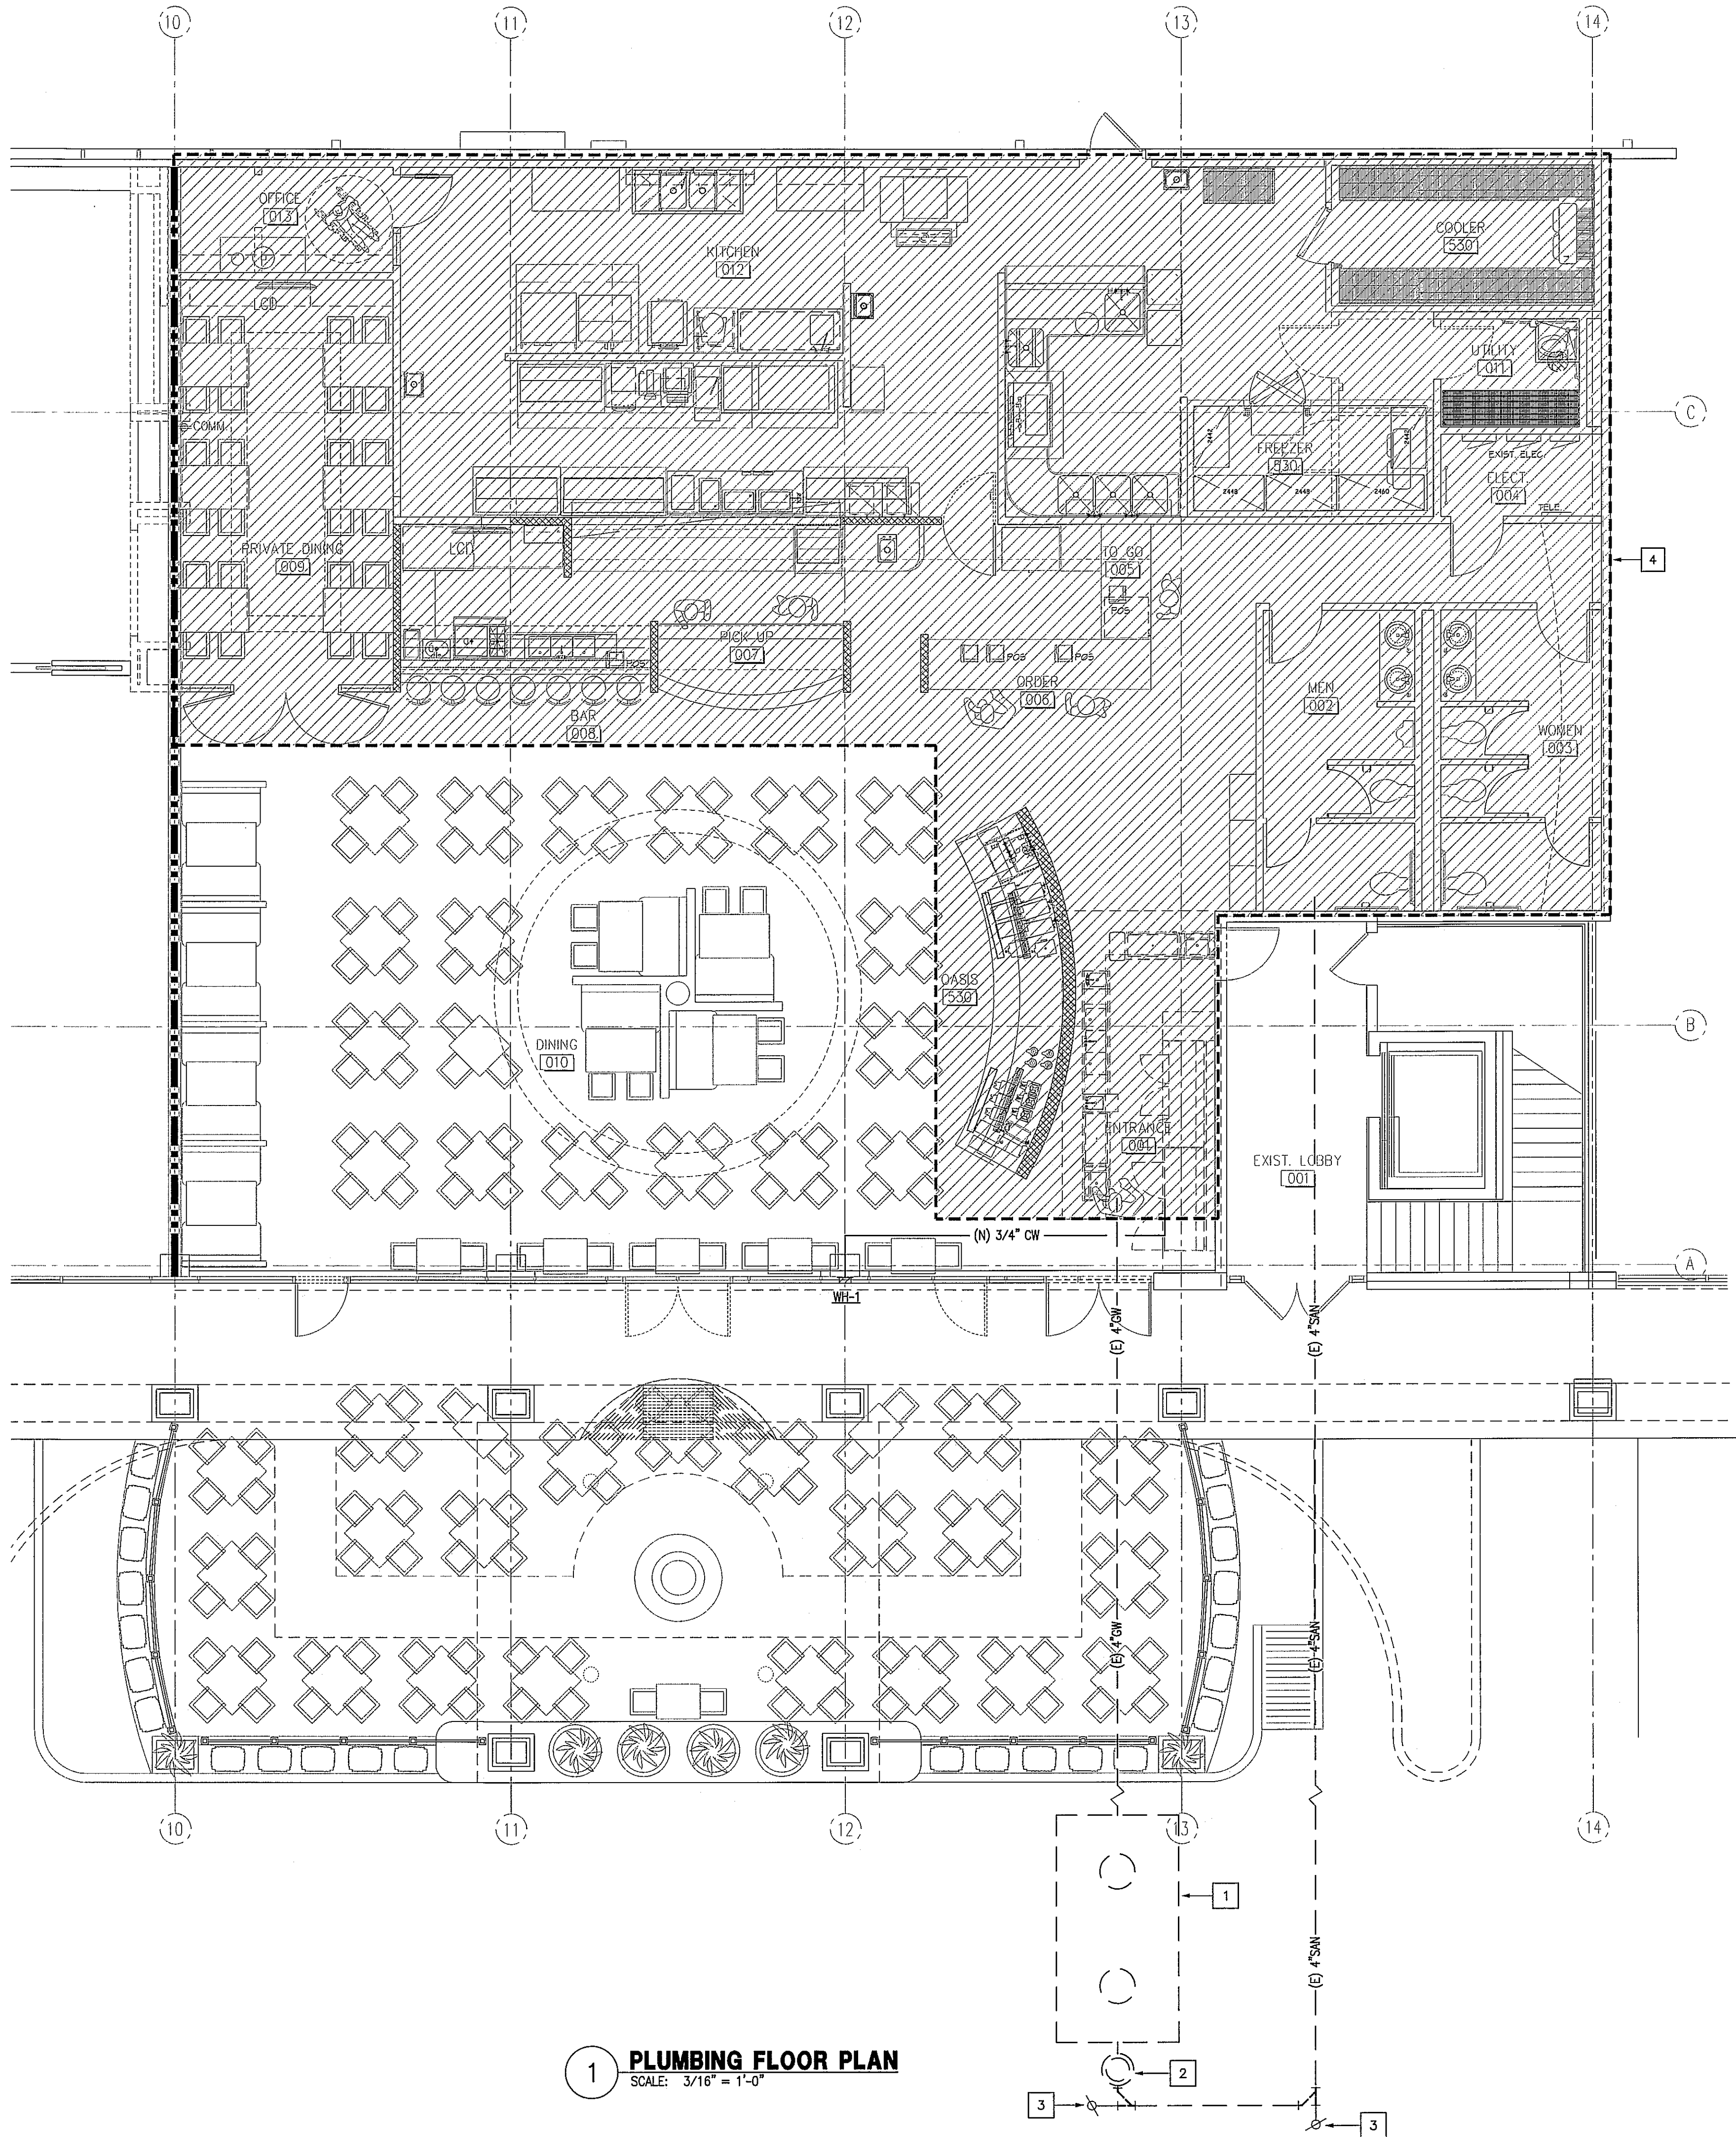

HARRELL
ARCHITECTS, LP

9575 Katy Frwy., #200
Houston, Texas 77024
tel: 713.722.7071
fax: 713.722.7072

CONSULTANTS

Holste & Associates, Inc.
Consulting Engineers - Texas Reg. F-5413
6071 Southwest Freeway, Suite 550
Houston, Texas 77074 (713) 995-1351
www.holstemap.com
Contact: Kris Odum (832) 643-0368

PROJECT NAME



Cafe Express Restaurant

PROJECT ADDRESS

3800 SW. Freeway, Suite 124
Houston, Texas 77027

PROJECT NUMBER

11039

SHEET NAME

PLUMBING

FLOOR PLAN

SHEET NUMBER

P1.1