

WALK-IN SPECIFICATIONS

SIZE: 14'-5 1/2" X 8'-8 1/2" X 8'-6 1/4" (1072.84 CU.FT.)

PANELS: ALL FOAMED PANELS ARE 4"

EXTERIOR FINISH:

26 GA STUCCO GALVALUME
EXTERIOR TOP - 26 GA STUCCO GALVALUME

INTERIOR FINISH:

WALLS: 26 GA STUCCO GALVALUME
COOLER CEILING: 26 GA STUCCO GALVALUME
FREEZER CEILING: 26 GA STUCCO GALVALUME

FLOOR TYPE:

COOLER - 4" VINYL FOAM SCREED
FREEZER - .100 SMOOTH ALUMINUM

HEIGHT:

COOLER - OD 8'-6 1/4" ID 8'-2 1/4"
FREEZER - OD 8'-6 1/4" ID 7'-10 5/8"

DOORS:

DOOR A850304040404
57.5X94.25DS 34X78 DR RH SCD CLR
FRAME=GL/GL PLUG=GL/GL
115-60-1/1.0 AMPS
DOOR A881004040404
57.5X94.25DS 34X78 DR LH STD FZR
FRAME=GL/GL PLUG=GL/GL
115-60-1/1.9 AMPS

ACCESSORIES:

(10) LF VINYL COVE BASE

REFRIG: AIR COOLED / PRE-CHARGED LINES


DOOR A850304040404
THRESHOLD DETAIL 50
57.5X94.25DS 34X78 DR RH SCD CLR
FRAME=GL/GL PLUG=GL/GL

INSULATION-
-A8 25
SMOKE DEVELOPMENT 500
ALL PANEL TO BE UL
LISTED THERMAL BARRIER
SHALL HAVE AN INDEX OF 15

DO NOT USE this drawing for installation

IMPORTANT NOTES:

- 1) ALLOW MINIMUM 1" CLEARANCE ALL AROUND
- 2) WALK-IN CEILING IS NOT DESIGNED FOR FOOT TRAFFIC OR STORAGE.
- 3) GENERAL CONTRACTOR TO REFER TO DESIGN AND SPECIFICATIONS MANUAL FOR FLOOR DETAIL, IDENTIFICATION, MATERIALS AND SUBTRACT TO GENERAL CONTRACTOR AND MECHANICAL CONTRACTOR FOR THE SHEET METAL PANELING FACTORS MAY BE SUSCEPTIBLE TO STAINING DUE TO EXCESSIVE MOISTURE CREATED BY THE HYDRATION OF CONCRETE TYPE MATERIALS. THEREFORE, IT IS ABSOLUTELY NECESSARY THAT EACH ROOM BE PROPERLY VENTILATED. ALSO NOTE THAT SPECIAL PRECAUTIONS MUST BE TAKEN WHEN USING MERIC ACID DUE TO EFFECTS OF HYDROCHLORIC ACID FUMES HAVE ON ALUMINUM AND STAINLESS STEEL MATERIALS.
- 5) THIS DRAWING IS FOR APPROVAL PURPOSES ONLY AND IS NOT TO BE USED FOR INSTALLATION OF THIS WALK-IN. AN "AS-BUILT" DRAWING IS PROVIDED WITH EACH SHIPPED WALK-IN.

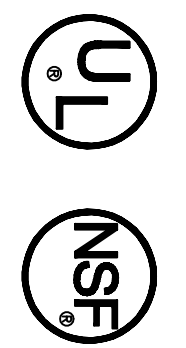

THIS DRAWING/ FILE IS THE PROPERTY OF KOLPAK WALK-IN AND IS NOT TO BE STORED IN ANY MANNER WITHOUT THE WRITTEN PERMISSION OF KOLPAK WALK-IN. ANY CHANGES TO THIS DRAWING WILL BE CHANGED IN THE DATA BASE.	SIGNED APPROVED PRINT MUST BE RECD. B/4 FAB.
<input type="checkbox"/> APPROVED AS DRAWN	<input type="checkbox"/> APPROVED AS NOTED
<input type="checkbox"/> APPROVED AS NOTED	<input type="checkbox"/> NOT APPROVED RESUBMIT
SIGNED _____	DATE _____

PLEASE VERIFY WALL HEIGHTS, ALL DIMENSIONS AND METAL FINISHES BEFORE APPROVING DRAWING.